Pacific Extended Blender Installation Diagram - Footprint

Note - Installer must print the Installation and Operators manual from the enclosed CD ROM and read and understand the Installation and Operation Instructions before installation.

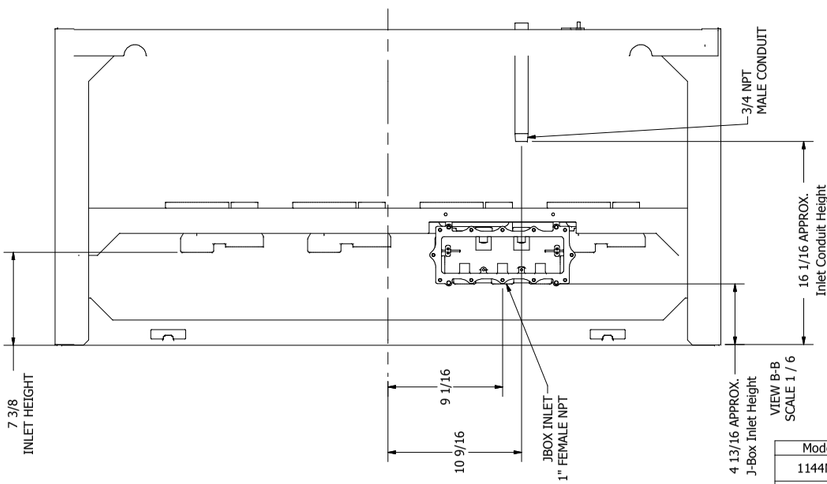

Hose Outlet

Model	1	2	3	4
1144M2	A,B,D		C	
1156E2	A,B		A,D	D
1136N2	A	B	D	
1148B2	A,C	A	C	D
1156B2	A,D		B	C
1148N2	D	A	B	C
1154E2	A,B		A,C	

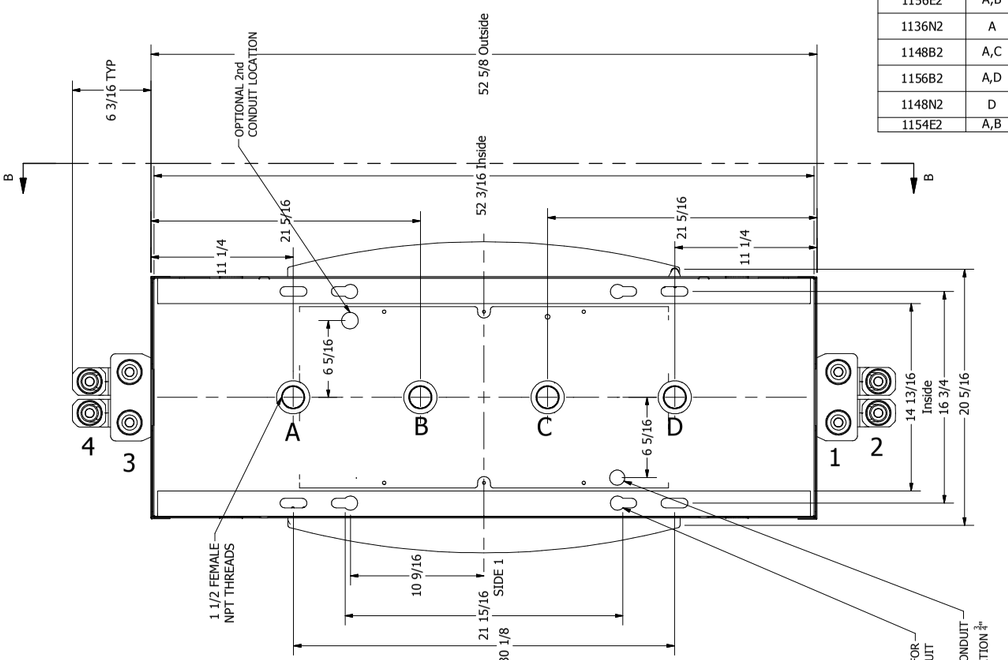

CAUTION: DISPENSERS MUST BE INSTALLED WITH A SUITABLE POWER OPERATED PUMP INCORPORATING A PROVISION FOR EXPANSION REFLIEF WHICH WILL RELIEVE AT PRESSURES NOT TO EXCEED 50 LBS. PER SQ. INCH. DO NOT USE LINE CHECK VALVE BETWEEN DISPENSER AND OPERATED PUMP UNLESS PROVIDED WITH RELIEF VALVES.

INLET PIPING SHALL BE MINIMUM SCHEDULE 40 STEEL PIPE WITH UL LISTED UNION INSTALLED PRIOR TO INSTALLATION INTO THE DISPENSER INLET. ALL JOINTS TO BE MADE USING CLASSIFIED PIPE JOINT SEALING COMPOUND.

THIS UNIT MUST BE ANCHORED TO THE ISLAND WITH A MINIMUM OF 4 BOLTS WITH MINIMUM DIAMETER OF 1/2" THROUGH THE BASE FRAME. DO NOT SHIM MIDDLE OF BASE RAILS TO BOLT DOWN DISPENSER. SHIM ONLY NEAR BOLTS.

DANGER: INSTALLATION TO CONFORM TO NATIONAL, STATE AND LOCAL CODES.

DANGER: IMPACT SAFETY VALVES ARE TO BE INSTALLED WITH SHEAR SECTION IN LINE WITH SURFACE OF ISLAND WITHIN ± 3/4". DEPENDING ON VALVE TO BE USED A LONGER OR SHORTER INLET NIPPLE MAY BE REQUESTED.

INSTALLER MUST SUPPLY 1-1/2" INLET PIPES, THREADED FOR INLET MANIFOLD (NPT THREAD), CUSTOMER TO PROVIDE PIPE, GROUND JOINT UNION, CONDUIT, AND FITTINGS TO ELECTRICAL AND PLUMBING INLETS. USE ONLY UL LISTED RIGID METAL CONDUIT AND UL LISTED SEALING FITTINGS WITH CONDUCTOR SEALS.

CAUTION: DISPENSERS MUST BE INSTALLED WITH PROVISIONS FOR EXPANSION RELIEF, WHICH WILL RELIEVE AT PRESSURES NOT EXCEEDING 50 PSI (345MPa).
DO NOT USE LINE CHECK VALVE BETWEEN DISPENSER AND TANK UNLESS PROVIDED WITH RELIEF VALVE.

127194
Rev C
SHT 1

BPC P/N: 127194

REV	BY	DATE	ECN NO.	DESCRIPTION
C	SMB	12/9/16	21173	
B	SMB	8/9/16	21067	
A	SAL	3/17/16	20929	

DRAWN: LAMBRIX 日期 DATE: 1/7/15
APP: 日期 DATE:
MATL SPEC NO:
TOLER SCALE:
DRAWING NUMBER: P4406s1
TITLE: FOOTPRINT DRAWING
PACIFIC EXTENDED BLENDER
材料 MATL:
BENNETT PUMP CO.
SPRING LAKE MI, 49456

图号 DRAWING NUMBER P4406s1
图幅 SIZE D
4

PROPRIETARY AND CONFIDENTIAL
THIS PRINT IS THE PROPERTY OF BENNETT PUMP CO. AND LOANED SUBJECT TO RETURN ON DEMAND. MAY NOT BE REPRODUCED WITHOUT OUR CONSENT.
版权和保密
此图是美国贝纳特公司的财产。借阅者应保存图纸不得复制、未经许可不得复制。
不按比例出图 DO NOT SCALE
等级 CLASS
图幅 SIZE D
图号 DRAWING NUMBER P4406s1